

Economiser

Installation of economisers after steam– and hot water boiler




Process description

The flue gas temperature after boilers is typically app. 220-230°C and still contains a large amount of energy. By installing a Danstoker economiser this energy can be used to increase the plant's performance and efficiency.

Danstoker economiser can be used as one of the following method:

- Feed water preheaters
- Heating of make up water
- Heating of hot water
- Direct mounting on Danstoker boilers
- Optional steel support (stand alone unit)
- Optional flue gas bypass

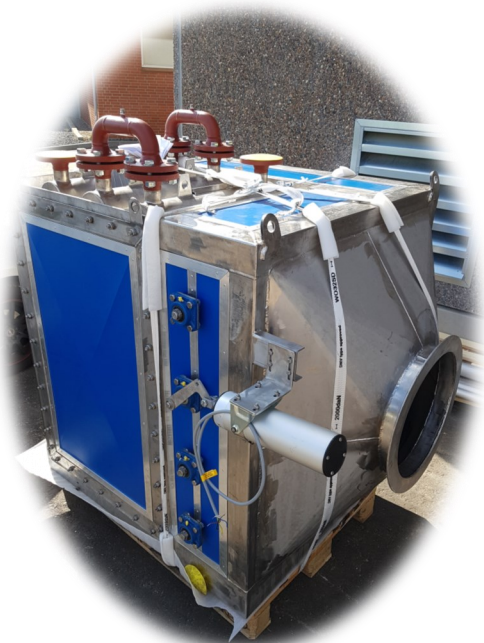

” Danstoker designs after clients requirements.